



FLPL10

Photoluminescent Exit Sign

Specifications

NO additional electrical or mechanical source required. Before installation, it must be determined that there is a minimum of 5Fc of LED or fluorescent light on the face(s) of the sign at all times during building occupancy.

UL 924 Emergency Lighting and Power Equipment Listed through ETL;



Meets NFPA Life Safety Code 101 and OSHA requirements;

International Building Code 2009; International Fire Code 2009

Standard Features

- High Illumination Non-Electric Photoluminescent Technology
- Non-Radioactive, Non-Toxic, Flame Retardant Materials
- Impact-Resistant, Waterproof
- Long Life Corrosion-Proof Construction (20 Yrs. Est.)
- High Visibility In Total Darkness And Smoke Filled Conditions
- Field Applied Directional Chevrons
- Suitable For Floor Proximity Installation
- 100 Ft Viewing Distance
- Abs Plastic Construction With Photoluminescent Lettering
- Lead Points Qualified
- Both High And Low Location Approved
- Can Be Relocated If Path Of Egress Changes
- Designed For Surface, Flag And Ceiling Mount With Optional frame and mounting bracket.

Mechanical Data

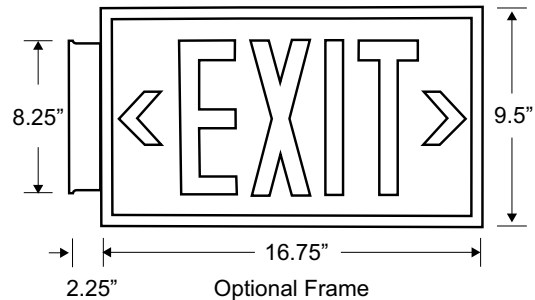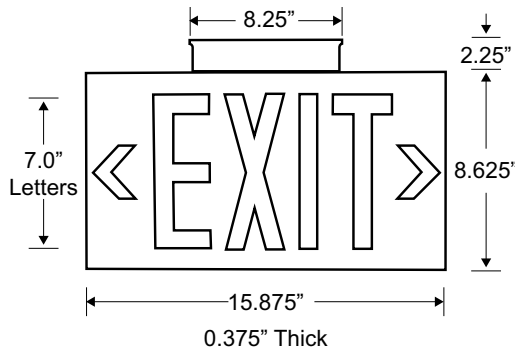

Multiple mounting options shown.

Part Number Matrix

FLPL10

S

Number of Faces
S = Single
D = Dual

G

Background Color
G = Green
R = Red

B

Frame Color
B = Black